


**NOTES:**

1. DIMENSIONS H, L & W TO BE SUFFICIENT TO PROVIDE A MINIMUM OF 200mm CLEARANCE AROUND THE VALVE & PIPE INSTALLATION.
2. ENCLOSURE TO BE MOUNTED ON 100 THICK CONCRETE BASE. LENGTH & WIDTH OF BASE TO EXTEND A MINIMUM OF 50mm BEYOND THE LENGTH & WIDTH OF THE ENCLOSURE. CONCRETE TO 20MPa MIX WITHOUT REINFORCEMENT.
3. THE FRAME IS AFFIXED TO THE CONCRETE BASE WITH A MINIMUM OF 4 x M12 'DYNABOLTS' OR EQUIVALENT.



A	ORIGINAL ISSUE	G.P.C.	01/2011
ISSUE	AMENDMENT DETAILS	INITIALS	DATE
0	10	20	30
40	50	100	150
200	250		

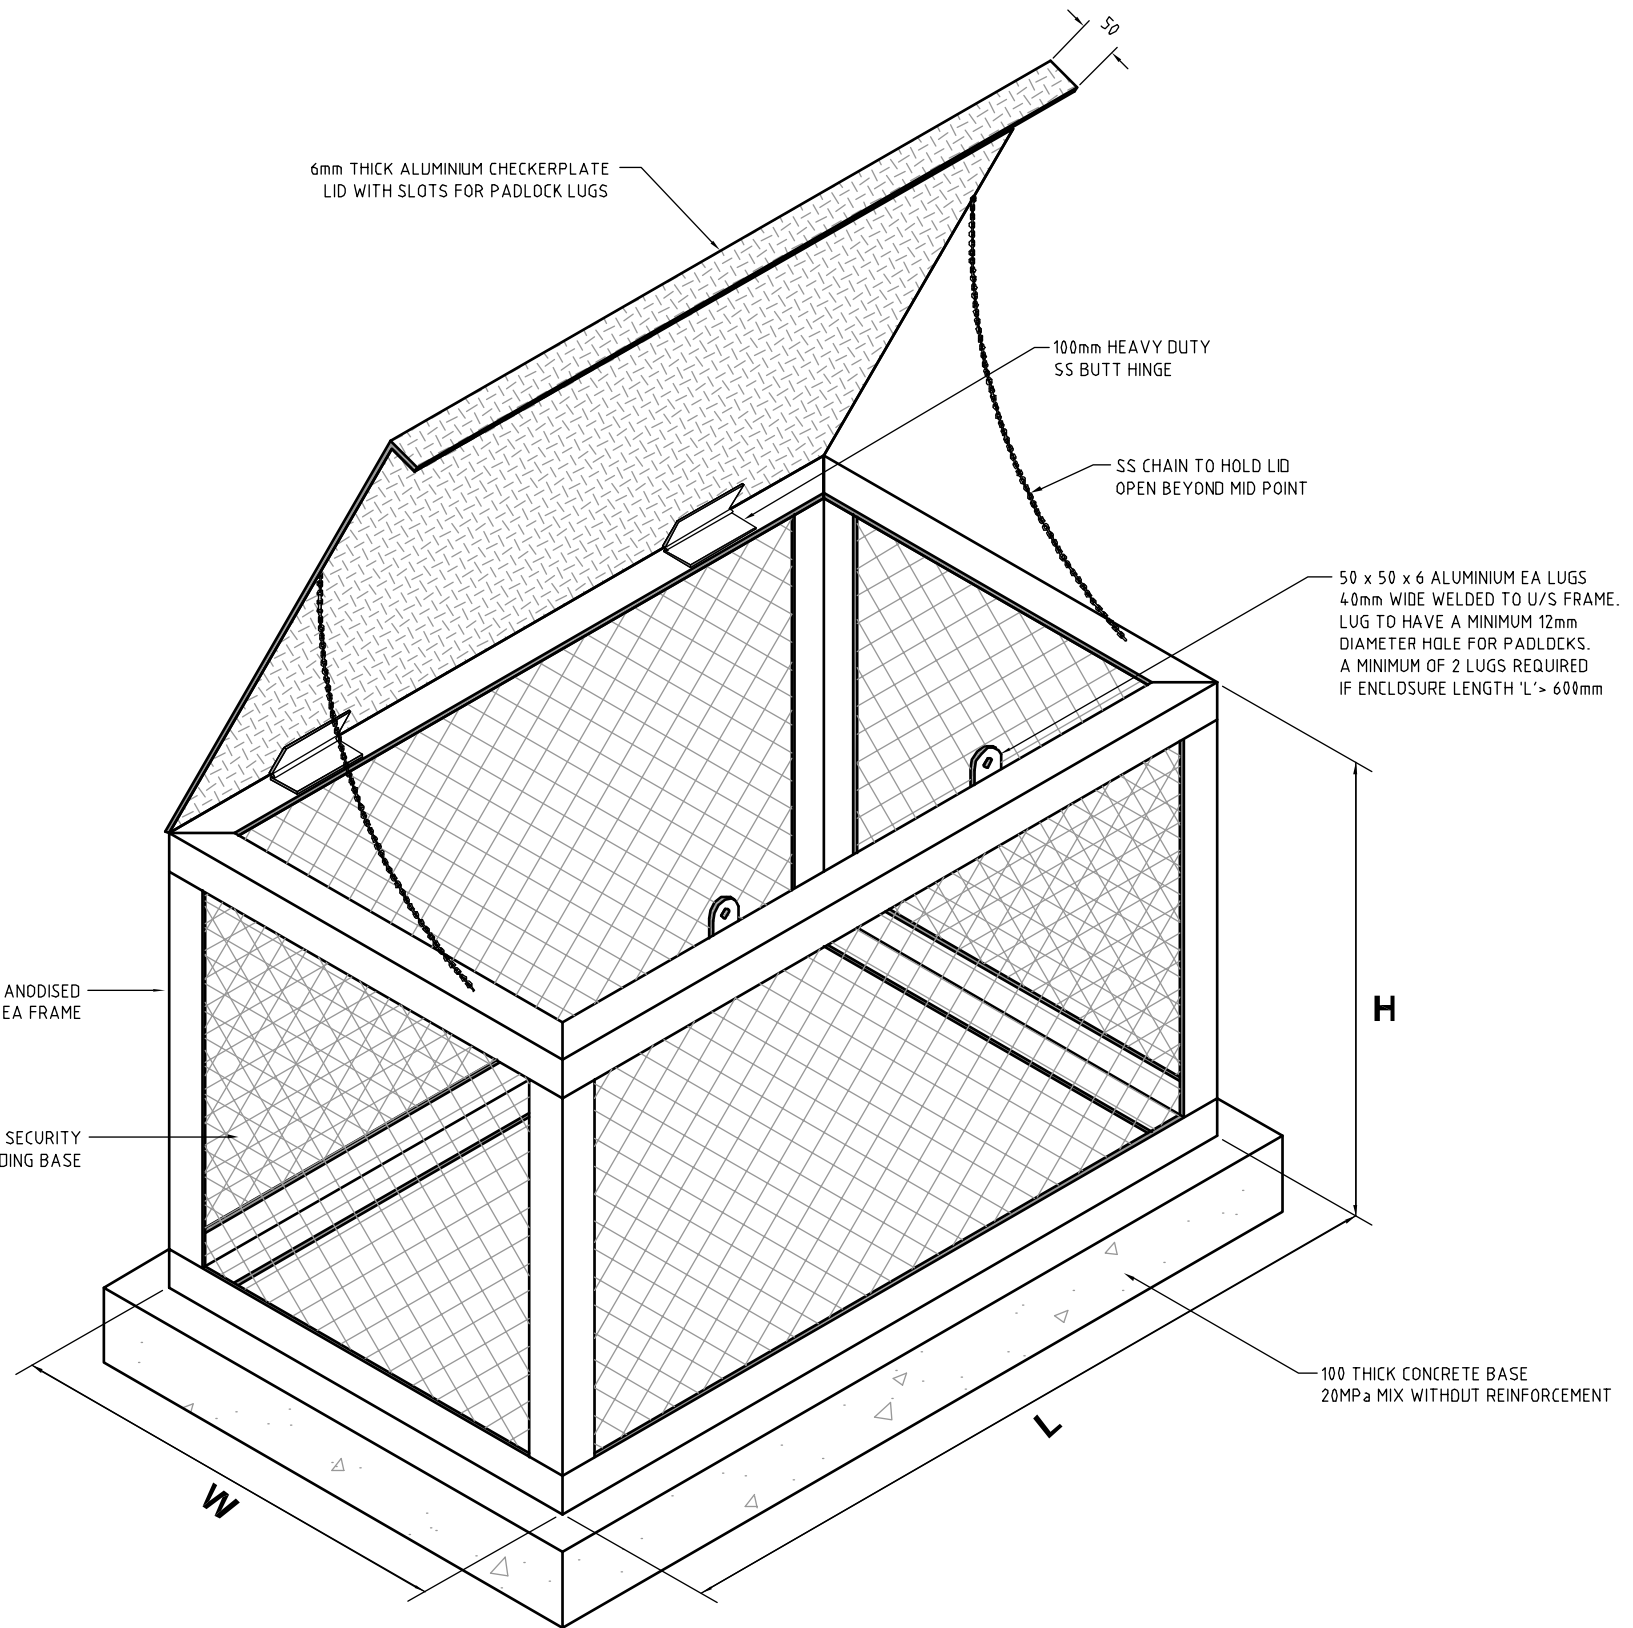

**DESIGN UNIT**  
 COUNCIL OFFICES  
 TUMBULOGUM ROAD,  
 MURWILLUMBAI,  
 NEW SOUTH WALES 2454  
 PHONE 02 6670 2400  
 FAX 02 6672 7513  
 WEBSITE www.tweed.nsw.gov.au

DESIGNER	<i>P. Phosse</i>	DATE 12.01.2011
DESIGN MANAGER	<i>P. Phosse</i>	DATE 12.01.2011
DRAWN	ENGINEERING & OPERATIONS DESIGN UNIT	
SCALE	1:10 [A3]	

PROJECT:	LANDSCAPING STANDARDS
PLAN TITLE:	IRRIGATION MANIFOLD ENCLOSURE

DRAWING NUMBER:	<b>S.D. 708</b>
	JAN. 2011