



ELEVATION
STANDARD HOUSE DRAIN CONNECTION TO SEWER FOR DRIVEWAYS

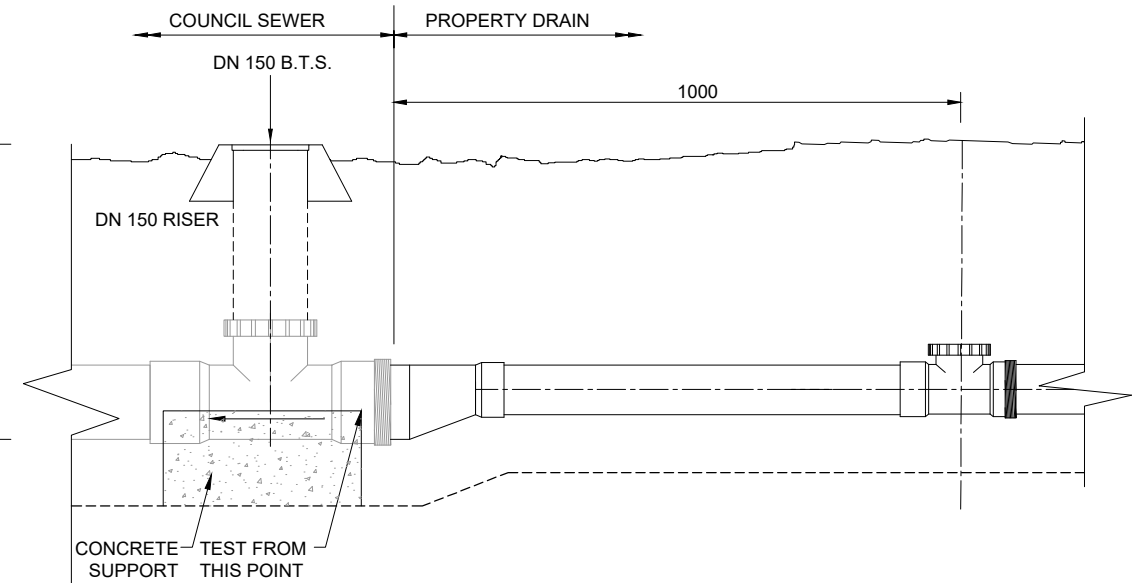

ELEVATION
STANDARD SHALLOW HOUSE DRAIN CONNECTION TO SEWER

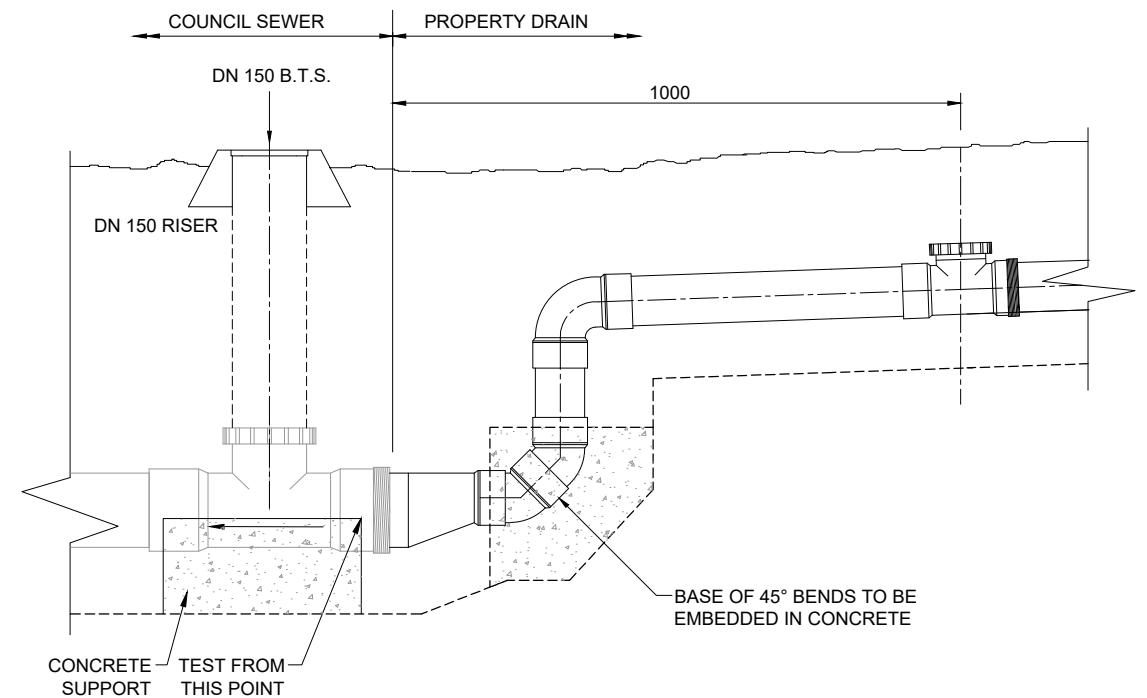

ELEVATION
STANDARD DEEP HOUSE DRAIN CONNECTION TO SEWER

NOTES

1. DN MEANS NOMINAL DIAMETER.
2. B.T.S MEANS BOLTED TRAP SCREW.
3. DRAINER TO TEST ALL DRAINAGE AT DN150 I.O WITH 150mm PLUG.
4. ONCE TEST IS COMPLETED, REMOVE PLUG, DO NOT RE-ATTACH SCREW CAP. INSTALL DN150 SHAFT TO SURFACE AND FIT DN150 B.T.S AND SURROUND.
5. WHERE THE INSPECTION SHAFT OR BOUNDARY TRAP RISER IS LIKELY TO BE DAMAGED BY VEHICULAR TRAFFIC, THE CAP MAY BE INSTALLED BELOW SURFACE LEVEL. ACCESS SHALL BE PROVIDED IN ACCORDANCE WITH THE FOLLOWING:
 - A. A HEAVY-DUTY TRAFFICABLE COVER SHALL BE INSTALLED AT SURFACE LEVEL ABOVE AND INDEPENDENT OF THE CAP
 - B. THE COVER SHALL BE SUITABLY SUPPORTED SO THAT NO LOAD CAN BE TRANSMITTED ONTO THE SHAFT
 - C. THE SHAFT SHALL BE TERMINATED JUST BELOW THE UNDERSIDE OF THE COVER.
6. THE DEPTH OF THE INVERT OF INSPECTION TEE SHALL BE NO GREATER THAN 1.5m UNLESS A GREATER DEPTH IS REQUIRED TO SERVICE A MINIMUM OF 90% OF EACH LOT IN ACCORDANCE WITH THE REQUIREMENTS OF AS/NZS 3500.2:2018 SECTION 4.
7. THE MINIMUM DEPTH OF THE SOFFIT OF THE SEWER CONNECTION POINT SHALL BE 1.2, OR IN ACCORDANCE WITH WSA02-2014-3.1 CLAUSE 5.6.5 SUBJECT TO APPROVAL OF THE DIRECTOR.

C	NOTES AMENDED AND CONNECTION TO SEWER FOR DRIVEWAYS ADDED	S.K.J	03.2019
B	NOTE No.4 ADDED & PLAN FORM UPGRADED	G.P.C.	06.2015
A	ORIGINAL ISSUE	J.P.	05.2006
ISSUE	AMENDMENT DETAILS	INITIALS	DATE



DESIGN UNIT
COUNCIL OFFICES
TUMBULGUM ROAD,
MURWILLUMBAH,
NEW SOUTH WALES 2484
PHONE 02 6670 2400
FAX 02 6672 7513
WEBSITE www.tweed.nsw.gov.au

DESIGN ENGINEER	<i>Adna</i>	DATE 11.05.15
DESIGN MANAGER	<i>P. King</i>	DATE 15.05.15
DRAWN	ENGINEERING & OPERATIONS DESIGN UNIT	
SCALE	NOT TO SCALE	

PROJECT:	SEWERAGE WORKS STANDARDS
PLAN TITLE:	PROPERTY DRAIN CONNECTION TO COUNCIL SEWER

DRAWING NUMBER:	S.D. 252
	JUNE 2015

