


PLAN

FITTING SCHEDULE		
ITEM	DESCRIPTION	No
1	EXISTING COUNCIL WATER MAIN	
2	MULTIFIT GIBALTY FBN COATED WITH S/S NUTS & BOLTS	2
3	DICL TEE SP/SP/FL	1
4	SLUICE VALVE FL/FL, RESILIENT SEATED, FBN COATED	3
5	DICL PIPE, DN 100 MINIMUM	
6	DICL TEE FL/FL/FL	1
7	DICL PIPE PIECE FL/FL	4
8	DICL 90° BEND FL/FL	9
9	LINE STRAINER	1
10	ELSTER C4000 COMBINATION METER	1
11	DOUBLE CHECK VALVE	1
12	FIRELINE DOUBLE DETECTOR CHECK VALVE (35Kpa 1ST CHECK ASSEMBLY)	1
13	DICL PIPE PIECE FL/FL 300mm LONG	1
14	40mm DOUBLE CHECK VALVE	1
15	40mm BALL VALVE	2
16	40mm 'Y' STRAINER	1
17	40mm WATER METER	1
18	40mm TYPE 'A' COPPER TUBE	
19	RISING SPINDLE SLUICE VALVE FL/FL, RESILIENT SEATED, FBN COATED	2

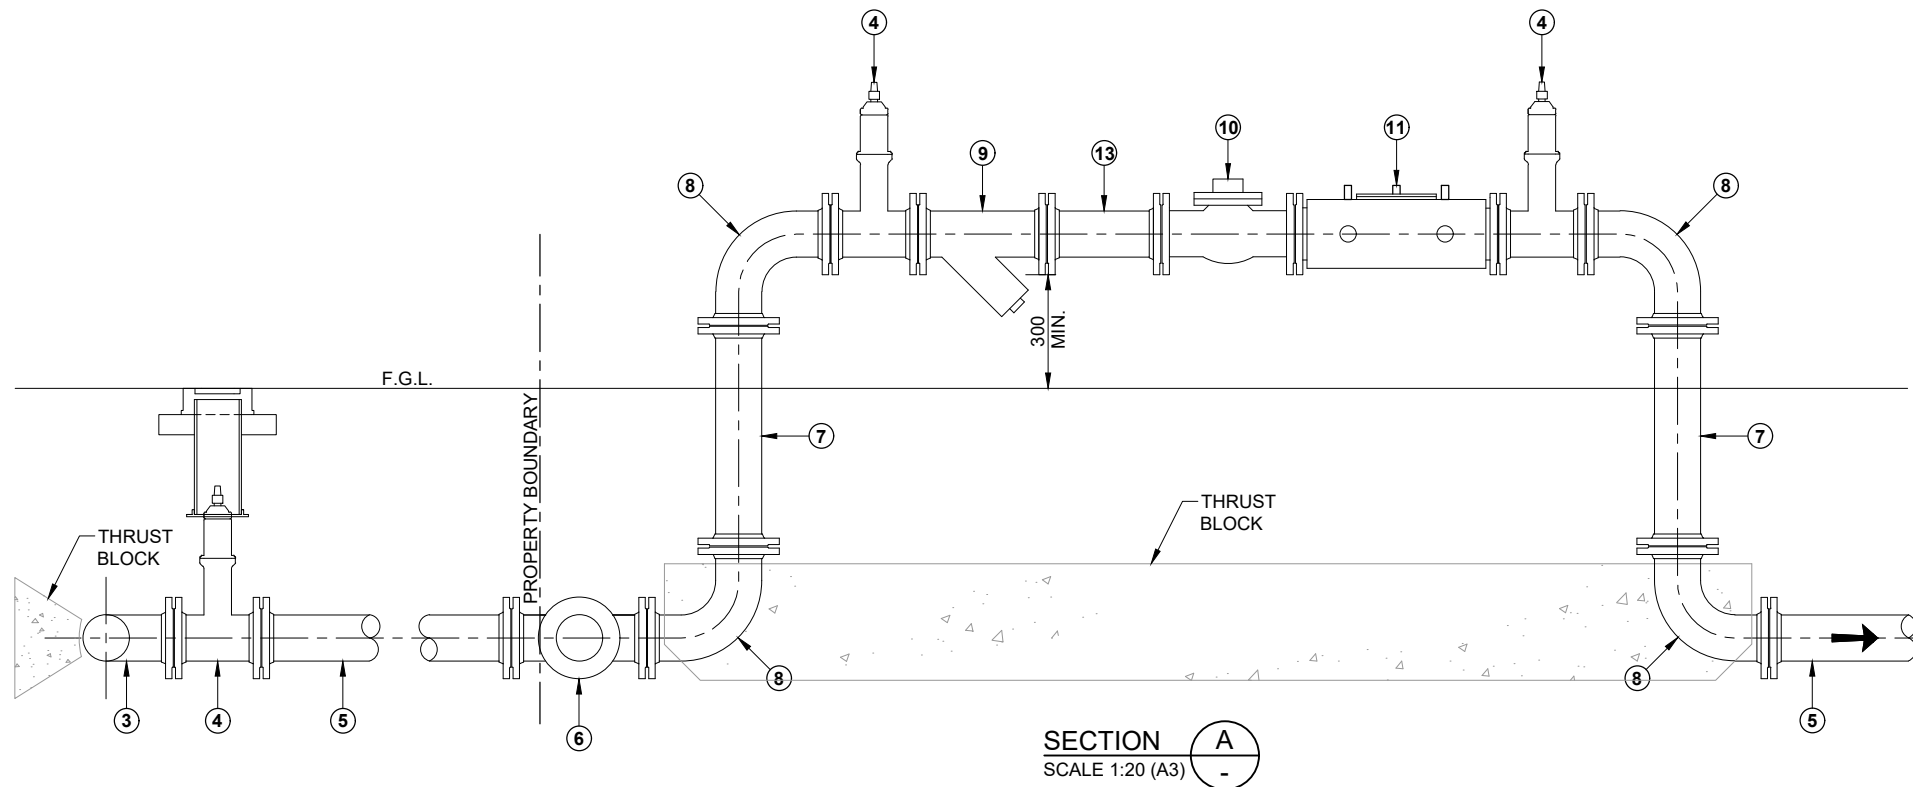

SECTION A
SCALE 1:20 (A3)

- NOTES:**
- ANY IRRIGATION TAKEN OFF THE DOMESTIC SERVICE SHALL REQUIRE AN ADDITIONAL BACKFLOW PREVENTION DEVICE TO BE INSTALLED AT TAKE OFF POINT.
 - ALL PIPE FITTINGS TO COMPLY WITH TWEED SHIRE COUNCIL SUPPLY CONTRACT SPECIFICATION, REFER TO STANDARD DRAWING S.D. 322.
 - CONTRACTOR SHALL BE RESPONSIBLE FOR CHECKING PIPE LENGTHS AND FITTINGS TO ENSURE CONSTRUCTABILITY PRIOR TO ORDERING PIPES AND FITTINGS.
 - LOCKED CHAIN TO BE INSTALLED ON VALVES WITH TSC 888 PADLOCK.
 - SINGLE DETECTOR CHECK CAN BE USED ON DOMESTIC INSTALLATIONS ONLY WHEN AVAILABLE PRESSURE IS BELOW 300kpa

ISSUE	AMENDMENT DETAILS	INITIALS	DATE
C	NEW FITTING FOR ITEM 10 IN SCHEDULE	J.M.M.	05.2023
B	NOTES AMENDED & PLAN FORM UPGRADED	G.P.C.	06.2015
A	ORIGINAL ISSUE	J.P.	05.2006



DESIGN UNIT

COUNCIL OFFICES
TUMBULGUM ROAD,
MURWILLUMBAH,
NEW SOUTH WALES 2484

PHONE 02 6670 2400
FAX 02 6672 7513
WEBSITE www.tweed.nsw.gov.au

DESIGN ENGINEER	<i>[Signature]</i> DATE 11.05.15
DESIGN MANAGER	<i>[Signature]</i> DATE 22.05.15
DRAWN	ENGINEERING & OPERATIONS DESIGN UNIT
SCALE	AS SHOWN

PROJECT:	WATER SUPPLY STANDARDS	DRAWING NUMBER:	S.D. 325
PLAN TITLE:	DN100 OR LARGER PROPERTY SERVICE WITH DN100 OR LARGER SEPARATE FIRE SERVICE		MAY 2023

ACAD FILE No: G:_AAA TSC STANDARD DRAWINGS\300 WATER SUPPLYS.D.325 (June-15 Rev B).dwg

0|mm 10|mm 20|mm 30|mm 40|mm 50|mm 100|mm 150|mm 200|mm 250|mm